



**Design No. P555**  
**BXUV.P555**  
**Fire-resistance Ratings - ANSI/UL 263**

Page Bottom

**Design/System/Construction/Assembly Usage Disclaimer**

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
- Authorities Having Jurisdiction should be consulted before construction.
- Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
- When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
- Only products which bear UL's Mark are considered Certified.

**BXUV - Fire Resistance Ratings - ANSI/UL 263**

**BXUV7 - Fire Resistance Ratings - CAN/ULC-S101 Certified for Canada**

[See General Information for Fire-resistance Ratings - ANSI/UL 263](#)

[See General Information for Fire Resistance Ratings - CAN/ULC-S101 Certified for Canada](#)

**Design No. P555**


March 16, 2015


**Restrained Assembly Rating - 1 Hr**

**Unrestrained Assembly Rating - 1 Hr**

**This design was evaluated using a load design method other than the Limit States Design Method (e.g., Working Stress Design Method). For jurisdictions employing the Limit States Design Method, such as Canada, a load restriction factor shall be used – See Guide [BXUV](#) or [BXUV7](#)**

**\* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

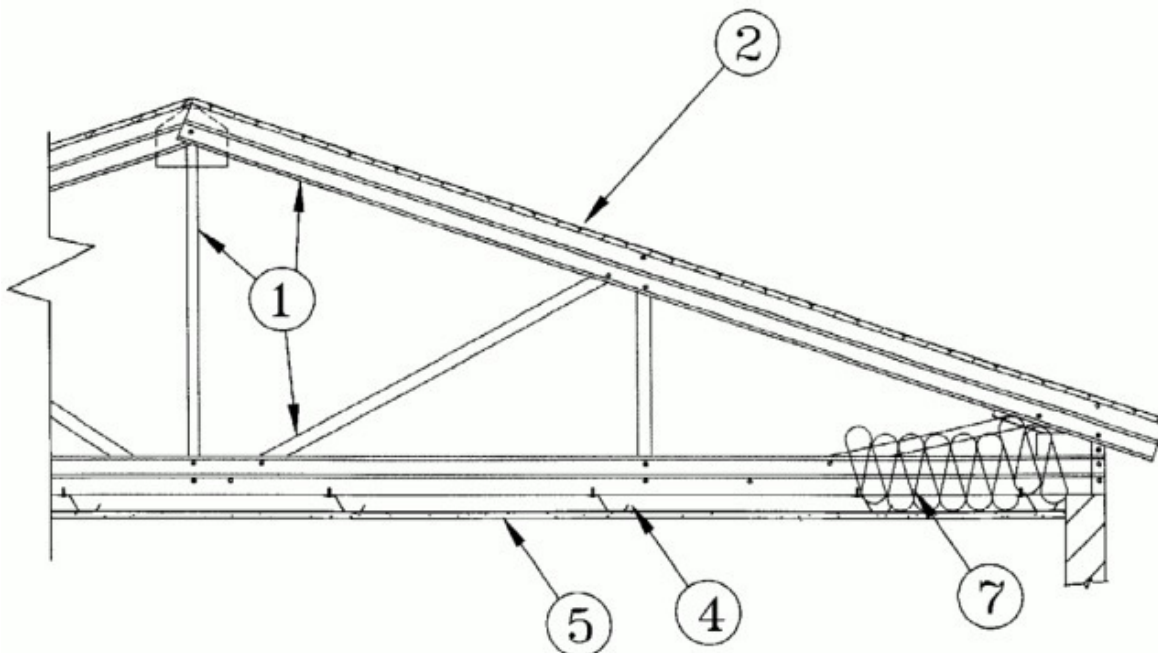

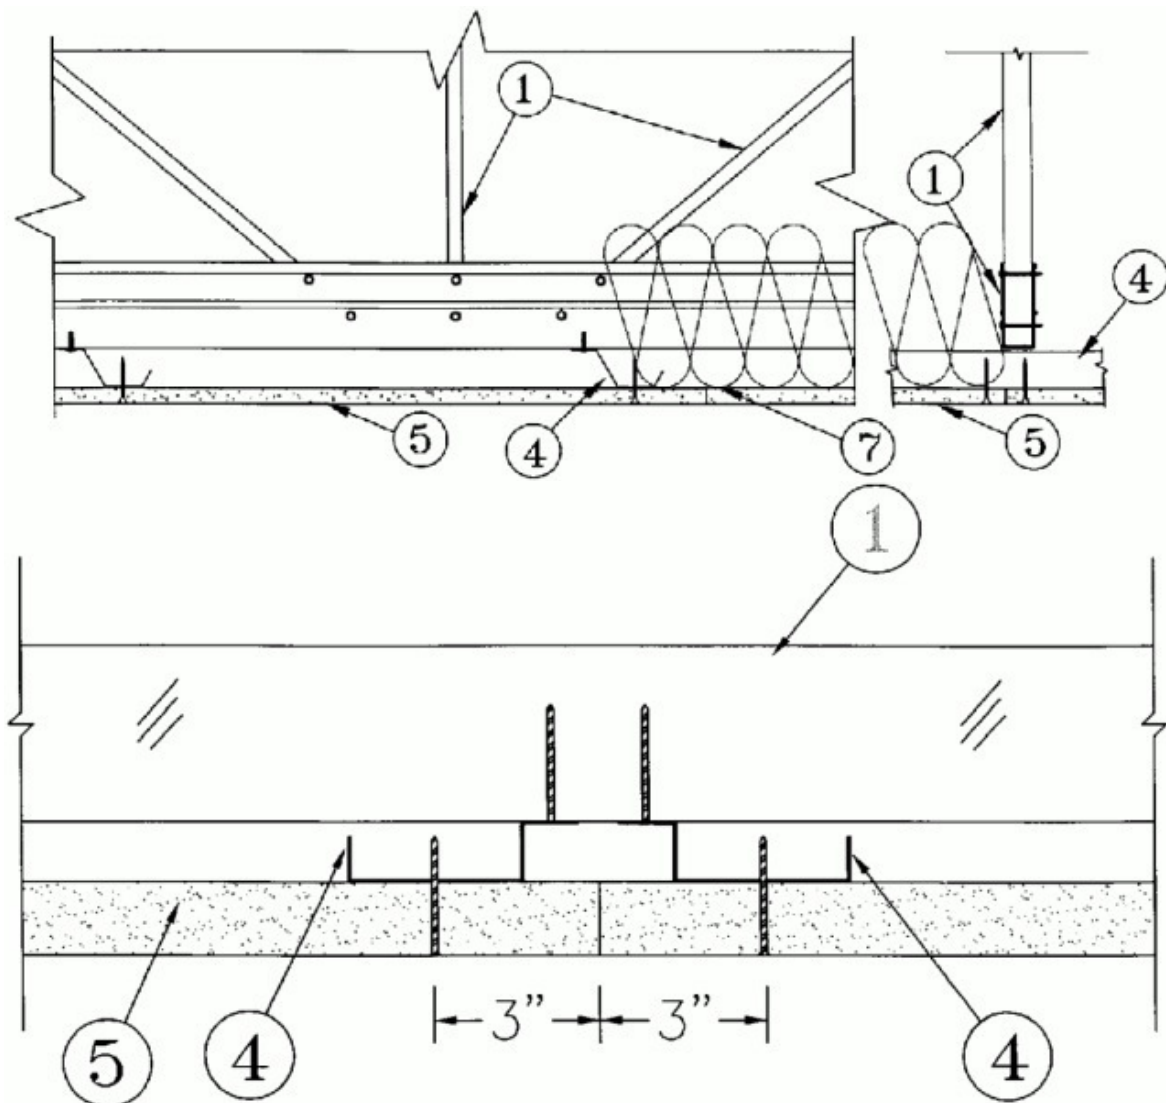

**END JOINT DETAIL**

**1. Structural Steel Members\*** — Pre-fabricated light gauge steel truss system consisting of cold-formed, galvanized steel chord and web members. Trusses fabricated in various sizes, depths, and from various steel thickness. Trusses spaced a max of 24 in. or 48 in. O.C. (See Items 2 and 7).

**AEGIS METAL FRAMING, DIV OF MITEK** — Ultra-Span, Pre-fabricated Light Gauge Steel Truss System

**ALLIED STUDCO** — Amkey System, Pre-fabricated Light Gauge Steel Truss System

**STEEL CONSTRUCTION SYSTEMS INC**

**TRUSSTEEL, DIV OF ITW BUILDING COMPONENTS INC** — TrusSteel

**1A. Structural Steel Members\*** — As an alternate to Item 1 - Pre-fabricated steel truss system consisting of cold-formed, galvanized steel chord and web sections. Trusses spaced a max of 48 in. OC. Trusses fabricated in various sizes, depths, and from various steel thicknesses. Truss ends placed over and secured to Bearing Seats (Item 1B) with two min. #10 by 3/4 in. long screws on each side of Bearing Seats. Allowable loading must be calculated so as to stress the steel trusses to a maximum of 98% of the stress calculated in accordance with the allowable stress design approach outlined in the manufacturer's load tables.

**EISEN PANEL SYSTEMS L L C** — Type Gateway Panel pre-fabricated steel truss system.

**1B. Bearing Seats\*** — (Not Shown) - for use with Item 1A — Galvanized steel tube, min. 1 in. by 2-1/2 in. by 13 ga., oriented vertically and welded to min. 4 in. by 4 in. by 10 ga., galvanized steel plate. Bearing seats spaced 48 in. OC and attached to bearing supports by welding or screw attaching the steel plate to the bearing supports.

**EISEN PANEL SYSTEMS L L C** — Type Gateway Panel bearing seat.

**2. Roof System\*** — (Not Shown) — Any UL Class A, B, or C Roofing System (TGFU) or Prepared Roof Covering (TFWZ) acceptable for use over nom 23/32 in. thick plywood sheathing. Nom 23/32 in. thick plywood sheathing mechanically fastened to top chord of steel trusses with 1-1/4 in. long Type S or S-12 steel screws spaced a max of 12 in. O.C. As an option, the plywood decking may be installed to min 20 ga. steel purlins or steel hat channels. Steel purlins or hat channels to be spaced a max 24 in. O.C. and welded or mechanically fastened, transverse to steel roof trusses (Item 1). As an alternate, plywood sheathing may be reduced to 15/32 in. when Item 1 is spaced 24 in. O.C. and a min of 9-1/2 in. thickness insulation (Item 7) is used.

**2A. Steel Roof Deck** — (Not Shown) — In lieu of, or in addition to the plywood decking described in Item 2, the steel roof deck may consist of corrugated or fluted steel form units, min 9/16 in. deep, 22 MSG painted or galv steel, welded or mechanically fastened at a max 12 in. O.C. to the top chord of the roof trusses (Item 1). When used in addition to the wood structural panels described in Item 2, Batts and Blankets (Item 7) is optional. When used lieu of the wood structural panels described in Item 2, Batts and Blankets (Item 7) must be used and the Class A, B or C Roofing System must include a min 3/4 in. thickness of roof insulation. If polystyrene roof insulation is used, it must be installed on top of a min 1/2 in. thickness of unclassified gypsum boards.

**2B. Subflooring (Alternate) - Structural Cement-Fiber Units\*** — In lieu of the plywood decking described in Item 2 - Nominal 19 mm (3/4 in.) thick tongue and groove structural cement-fiber units. Long dimension of panels to be perpendicular to trusses with end joints staggered. Panels fastened to the trusses with #10 self-drilling, self-tapping cement board screws 1-3/4 in. long. Screws shall be spaced 6 in. OC along the perimeter of each sheet and 12 in. OC in the field of each sheet. Screws shall be spaced 1/2 in. from end joints and 1 in. from side joints.

**ECTEK INTERNATIONAL INC** — Armoroc Panel

**3. Vapor Barrier** — (Not Shown)—Optional—Commercial asphalt saturated felt, 0.030 in. thick, applied over the plywood.

**4. Furring Channels** — Resilient channels formed of 25 MSG galv steel, installed perpendicular to the steel trusses (Item 1), spaced a max of 16 in. O.C. when no insulation (Item 7 or 7A) is fitted in the concealed space, or a max of 12 in. O.C. when insulation (Item 7 or 7A) is fitted in the concealed space, draped over the resilient channel/gypsum board ceiling membrane. Two courses of resilient channel positioned 6 in. O.C. at gypsum board butt-joints (3 in. from each end of gypsum board). Channels oriented opposite at gypsum board butt-joints. Channel splices overlapped 4 in. beneath steel trusses. Channels secured to each truss with Type S12 by 1/2 in. long screws.

**5. Gypsum Board\*** — One layer of nom. 5/8 in. thick by 48 in. wide boards, installed with long dimension parallel to trusses. Attached to the resilient channels using 1 in. long Type S bugle-head screws. Screws spaced a max of 12 in. O.C. along butted end-joints and in the field when no insulation (Item 7 or 7A) is fitted in the concealed space or a max of 8 in. O.C. along butted end-joints and in the field when insulation (Item 7 or 7A) is fitted in the concealed space, draped over the resilient channel/gypsum board ceiling membrane.

**AMERICAN GYPSUM CO** — Type AG-C.

**6. Finishing System** — (Not Shown)—Vinyl, dry or premixed joint compound, applied in two coats to joints and screw-heads; paper tape, 2 in. wide, embedded in first layer of compound over all joints. As an alternate, nom 3/32 in. thick veneer plaster may be applied to the entire surface of gypsum board.

**7. Batt and Blankets\*** — Mineral wool or glass fiber insulation bearing the UL Classification Marking for Surface Burning Characteristics, having a flame spread value of 25 or less and a smoke spread value of 50 or less. Insulation fitted in the concealed space, draped over the resilient channel/gypsum board ceiling membrane. Min. 9-1/2 in. thickness required when 15/32 in. thick plywood sheathing is used (Item 2) or optional when used at any thickness and with 23/32 in. thick plywood sheathing (Item 2).

**7A. Loose Fill Material\*** — As an alternate to Item 7 — Loose fill material bearing the UL Classification Marking for Surface Burning Characteristics, having a flame spread value of 25 or less and a smoke spread value of 50 or less. Loose fill material fitted in the concealed space, draped over the resilient channel/gypsum board ceiling membrane. Min 9-1/2 in. thickness required when 15/32 in. thick plywood sheathing is used (Item 2) or optional when used at any thickness and with 23/32 in. thick plywood sheathing (Item 2).

**8. Bridging** — (Not Shown)—Location of lateral bracing for truss chord and web sections to be specified on truss engineering.

**Alternate Ceiling Membrane** — Not Shown.

**9. Steel Framing Members** —

a. **Main Runners** — Installed perpendicular to Structural Steel Members — Nom 10 or 12 ft long, 15/16 in. or 1-1/2 in. wide face, spaced 4 ft OC. Main runners hung a min of 2 in. from bottom chord of Structural Steel Members with 12 SWG galv steel wire. Wires located a max of 48 in. OC.

b. **Cross tees or channels** — Nom 4 ft long, 15/16 in. or 1-1/2 in. wide face, or cross channels, nom 4 ft long, 1-1/2 in. wide face, installed perpendicular to the main runners, spaced 16 in. OC. Additional cross tees or channels used at 8 in. from each side of butted wallboard end joints. The cross tees or channels may be riveted or screw-attached to the wall angle or channel to facilitate the ceiling installation.

c. **Wall angles or channels** — Used to support steel framing member ends and for screw-attachment of the gypsum wallboard — Min. 0.016 in. thick painted or galvanized steel angle with 1 in. legs or min. 0.016 in. thick painted or galvanized steel channel with a 1 by 1-1/2 by 1 in. profile, attached to walls at perimeter of ceiling with fasteners 16 in. OC.

**USG INTERIORS LLC** — Type DGL or RX

**10. Gypsum Board\*** — For use with Steel Framing Members (Item 9) when Batts and Blankets\* (Item 7) are not used - One layer of nominal 5/8 in. thick by 48 in. wide boards, installed with long dimension parallel to the main runners. Wallboard fastened to each cross tee or channel with five wallboard screws, with one screw located at the midspan of the cross tee or channel, one screw located 12 in. from and on each side of the cross tee or channel mid span, and one screw located 1-1/2 in. from each wallboard side joint. Except at wallboard end joints, wallboard screws shall be located on alternating sides of cross tee flange. At wallboard end joints, wallboard screws shall be located 1/2 in. from the joint. Wallboard fastened to main runners with wallboard screws 1/2 in. from side joints, midway between intersections with cross tees or channels (16 in. OC). End joints of adjacent

wallboard sheets shall be staggered not less than 32 in. Wallboard sheets screw attached to leg of wall angle with wallboard screws spaced 12 in. OC. Joints treated as described in Item 6. For use with **Steel Framing Members\*** (Item 9) when **Batts and Blankets\*** (Item 7) are used - Ratings limited to 1 Hour- 5/8 in. thick, 4 ft wide; installed with long dimension perpendicular to cross tees with side joints centered along main runners and end joints centered along cross tees. Fastened to cross tees with 1 in. long steel wallboard screws spaced 8 in. OC in the field and 8 in. OC along end joints. Fastened to main runners with 1 in. long wallboard screws spaced midway between cross tees. Screws along sides and ends of boards spaced 3/8 to 1/2 in. from board edge. End joints of the sheets shall be staggered with spacing between joints on adjacent boards not less than 4 ft OC.

**AMERICAN GYPSUM CO** — Type AG-C.

**\* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

Last Updated on 2015-03-16

---

[Questions?](#)

[Print this page](#)

[Terms of Use](#)

[Page Top](#)

© 2015 UL LLC

When the UL Leaf Mark is on the product, or when the word "Environment" is included in the UL Mark, please search the [UL Environment database](#) for additional information regarding this product's certification.

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2015 UL LLC".